KRONE AG
IHR PARTNER FÜR KÄLTE & KLIMA

GREE

Vorsicht !!!!!

Klemmen 1 + 2 sind ausschliesslich für die Kommunikation zwischen Innen- und Aussengerät vorgesehen.

Niemals 230 V Spannung anlegen!!

Keine externe Geräte anschlissen, z.B. Kondensatpumpen.
Das zerstört die Geräteelektronik.

Auf korrekte Verkabelung achten!
Klemmen 1 + 2 als Anschluss für die Gerätekommunikation nutzen!

Achten Sie darauf, dass die Verkabelung korrekt ist, um Schäden am Gerät zu vermeiden.

Schrauben fest anziehen, Sitz prüfen. Auf die richtige Erdung achten.
Gleiche Erdung für Innen- und Aussengerät verwenden.

Zugentlastung und Klemmenabdeckung müssen korrekt angebracht sein.

KRONE AG
Neugutstrasse 60
CH-8304 Wallisellen

Telefon: +41 44 918 72 52
E-Mail: info@krone-klima.ch

Ein Unternehmen der
treex evo GROUP



KRONE AG
IHR PARTNER FÜR KÄLTE & KLIMA

GREE

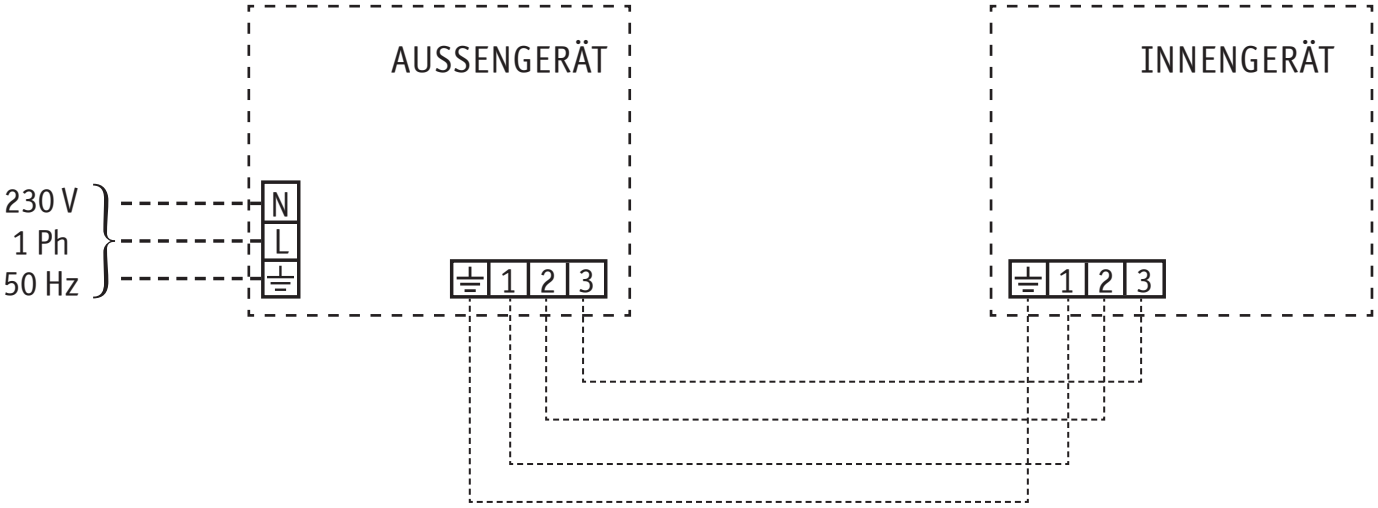

Empfohlene Absicherung 10 Ampere

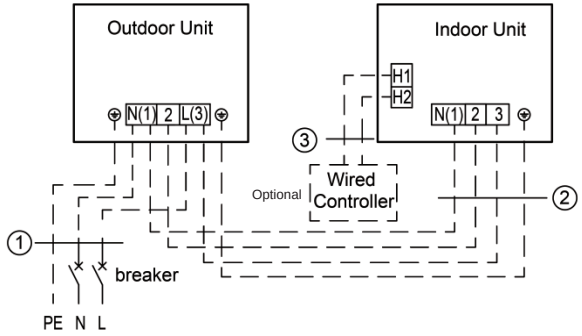

ELEKTRISCHE VERBINDUNG | SCHALTPLÄNE

Innengerät GUD035-ZD1

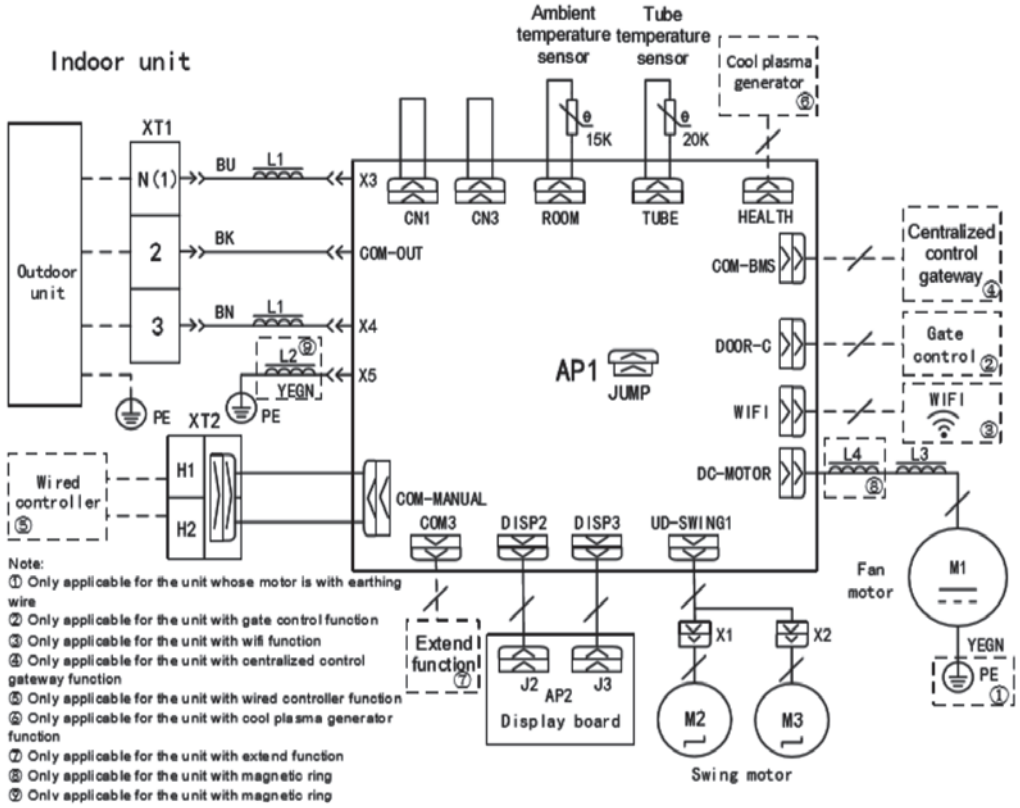

Note:
① Only applicable for the unit whose motor is with earthing wire
② Only applicable for the unit with gate control function
③ Only applicable for the unit with wifi function
④ Only applicable for the unit with centralized control gateway function
⑤ Only applicable for the unit with wired controller function
⑥ Only applicable for the unit with cool plasma generator function
⑦ Only applicable for the unit with extend function
⑧ Only applicable for the unit with magnetic ring
⑨ Only applicable for the unit with magnetic ring

Außengerät GUD035W1-S

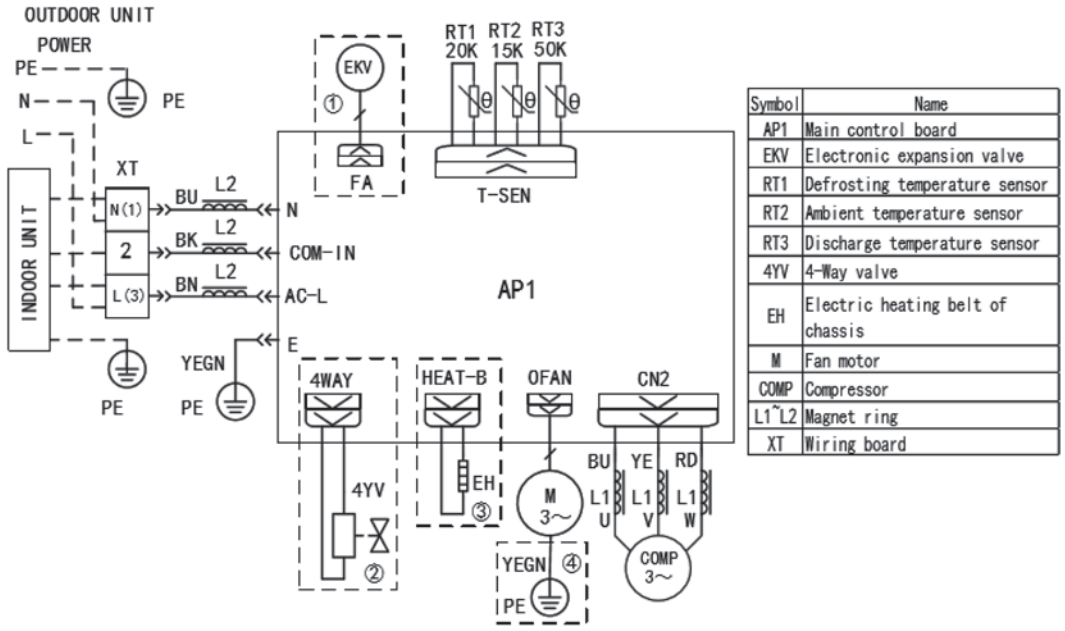

Symbol	Name
AP1	Main control board
EKV	Electronic expansion valve
RT1	Defrosting temperature sensor
RT2	Ambient temperature sensor
RT3	Discharge temperature sensor
4YV	4-Way valve
EH	Electric heating belt of chassis
M	Fan motor
COMP	Compressor
L1~L2	Magnet ring
XT	Wiring board

①:Only applicable for the unit with electronic expansion valve .

②:Only applicable for the unit with 4-way valve .

③:Only applicable for the unit with electric heating belt of chassis.

④:Only for the unit whose motor is with earthing wire.